


NOTICE - SOURCE FLUID POWER CLAIMS PROPRIETARY RIGHTS ON THE INFORMATION DISCLOSED ON THIS DRAWING. IT IS ISSUED IN CONFIDENCE FOR ENGINEERING INFORMATION ONLY AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING HEREDN WITHOUT DIRECT WRITTEN PERMISSION FROM SOURCE FLUID POWER TO THE USER.


| | | | |
|-----|------|----------|----|
| REV | DATE | REVISION | BY |
|-----|------|----------|----|

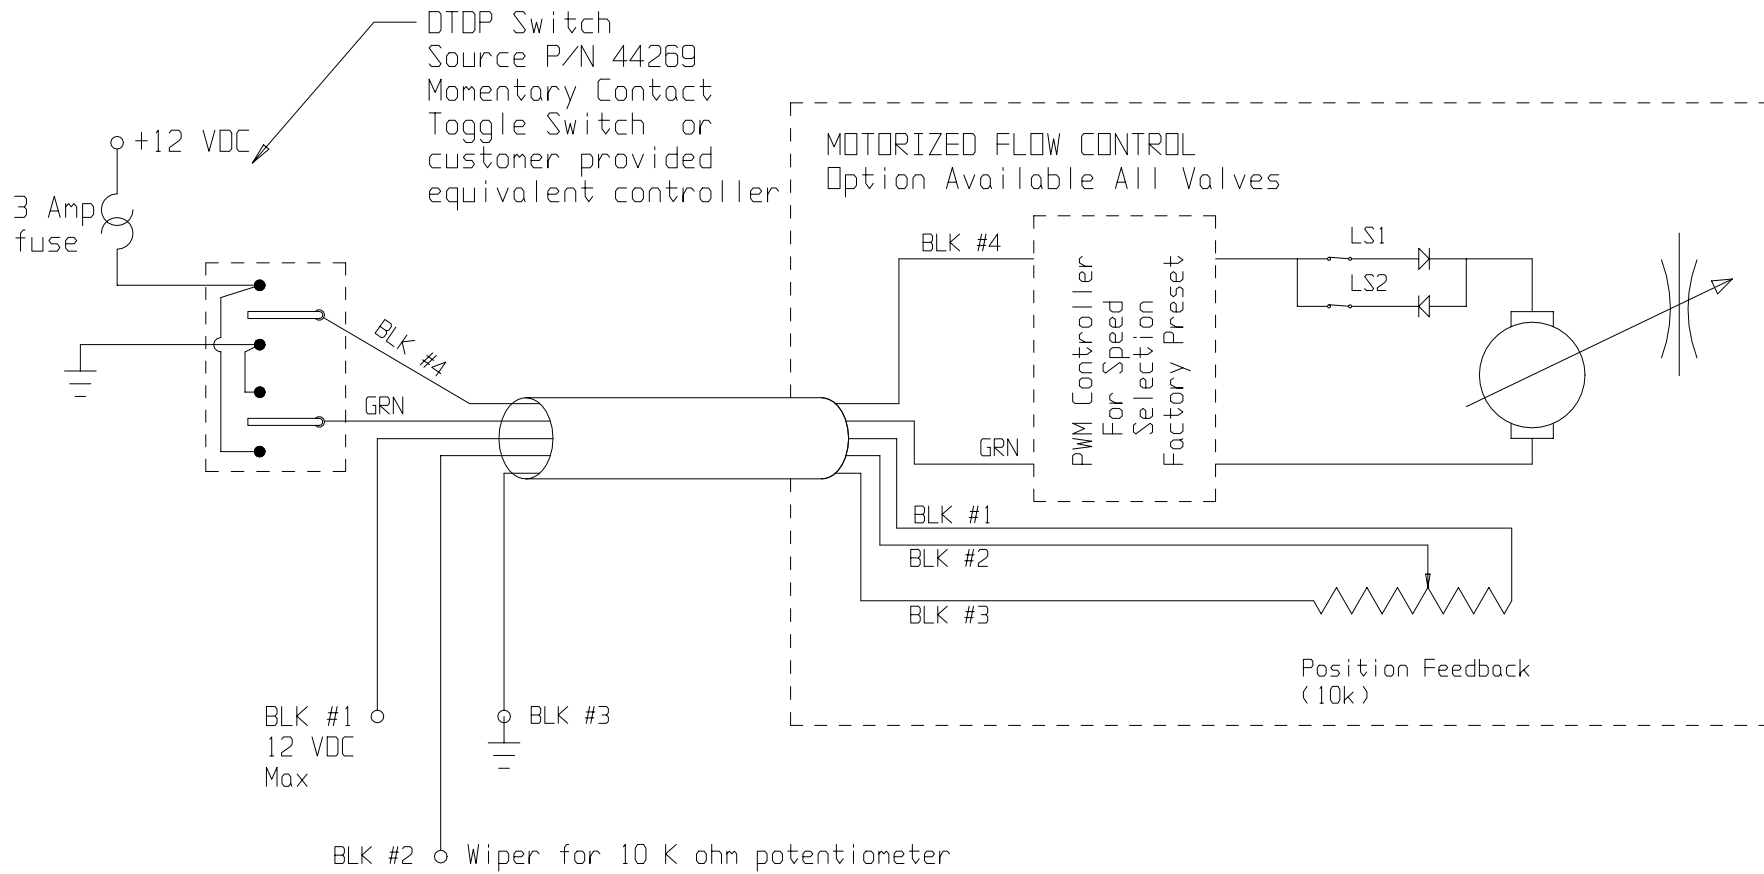

Please Note:
Motorized flow control has internal stroke limiting switches that set full open and closed valve positions. These limit points are not calibrated to the potentiometer limits. The customer must set these limit points within their control system.

Control Option Available:
Source Fluid Power's PEM-DMC controller card in conjunction with the 0.9 second feed back motor drive will calibrate switch position to feed back signal and sync to a customer provided 4-20 mA, 0-10 VDC, PWM or potentiometer command signal.

SIMILAR TO: USED ON:



SOURCE FLUID POWER
331 Lake Hazeltine Drive
Chaska, MN 55318
952-368-3866 (Fax) 952-448-3392

| | | | | |
|-------------|-----|-------|--------|--|
| DRAWN BY | GLM | DATE | 7/6/07 | TITLE Customer Connections to MTR ** *FB |
| CHECKED BY | | DATE | | |
| APPROVED BY | | DATE | | |
| PROJECT | | SCALE | | |